

INSTRUCTIONS FOR USE

Thank you for having chosen a Fantini Cosmi product. Before installing the instrument, please read these instructions carefully to ensure maximum performance and safety.

DESCRIPTION



Fig.1 — Front panel

- Setpoint button.
- Decrease button.

INDICATIONS

OUT1 Thermostat output

- Increase button.
- Exit / Stand-by button.

INSTALLATION

- Insert the controller through a hole measuring 71x29 mm.
- Make sure that electrical connections comply with the paragraph "wiring diagrams". To reduce the effects of electromagnetic disturbance, keep the sensor and signal cables well separate from the power wires.
- Fix the controller to the panel by means of the suitable clips, by pressingly gently; if fitted, check that the rubber gasket adheres to the panel perfectly, in order to prevent debris and moisture infiltration to the back of the instrument.
- Place the probe T1 inside the room in a point that truly represents the temperature of the stored product.

OPERATION

DISPLAY

During normal operation, the display shows either the temperature measured or one of the following indications:

OFF	Controller in stand-by	E1	In tuning: timeout1 error
OR	Probe T1 overrange or failure	E2	In tuning: timeout2 error
TUN / 5.4	Controller in autotuning	E3	In tuning: overrange error

SETPOINT (display and modification of desired temperature value)

- press button **SET** for at least half second, to display the setpoint value.
- By keeping button **SET** pressed, use button **DOWN** or **UP** to set the desired value (adjustment is within the minimum SPL and the maximum SPH limit).
- When button **SET** is released, the new value is stored.

STAND-BY

Button **EXIT** when pressed for 3 seconds, allows the controller to be put on a standby or output control to be resumed (with SB =YES only).

CONTROLLER AUTOTUNING IN PID MODE

Before starting

- Adjust the setpoint 1SP to the desired value.
- Set 1Y =PID.
- Make sure that the 1PB value matches the desired control mode (1PB <0 for heating; 1PB >0 for refrigeration).

Start autotuning

- Keep buttons **DOWN** + **UP** pressed for 3 seconds. 1CT blinks on the display.
- With **DOWN** + **UP** or **EXIT** set the cycle time in order to define the dynamic of the process to be controlled.
- To start autotuning press **DOWN** + **UP** or wait for 30 seconds. To abort the autotuning function, press **EXIT**.

During autotuning

- During the entire autotuning phase, the display alternates **TUN** with the actual temperature measured.
- In case of power failure, when power is resumed, after the initial autotest phase, the controller resumes the autotuning function.
- To abort the autotuning, without modifying the previous control parameters, keep button **EXIT** pressed for 3 seconds.
- After the autotuning has taken place successfully, the controller updates the control parameters and start to control.

Errors

- If the autotuning function failed, the display shows an error code:
- E1 timeout1 error: the controller could not bring the temperature within the proportional band. Increase 1SP in case of heating control, vice versa, decrease 1SP in case of refrigerating control and re-start the process.
- E2 timeout2 error: the autotuning has not ended within the maximum time allowed (1000 cycle times). Re-start the autotuning process and set a longer cycle time 1CT.
- E3 temperature overrange: check that the error was not caused by a probe malfunction, then decrease 1SP in case of heating control, vice versa increase 1SP in case of refrigerating control and then re-start the process.
- To eliminate the error indication and return to the normal mode, press button **EXIT**.

Control improvement

- To reduce overshoot, reduce the integral action reset 1AR.
- To increase the response speed of the system, reduce the proportional band 1PB. Caution: doing this makes the system less stable.
- To reduce swings in steady-state temperature, increase the integral action time 1IT; system stability is thus increased, although its response speed is decreased.
- To increase the speed of response to the variations in temperature, increase the derivative action time 1DT. Caution: a high value makes the system sensitive to small variations and it may be a source of instability.



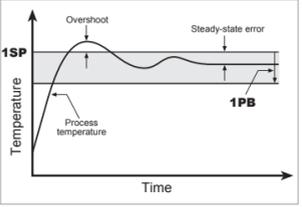
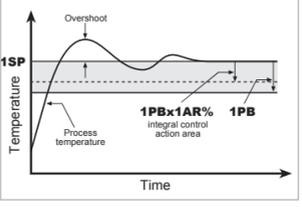
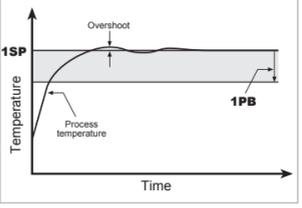
RECALIBRATION

- Have a precision reference thermometer or a calibrator to hand.
- Ensure that OS1 =0 and SIM =0.
- Switch the controller off then on again.
- During the auto-test phase, press buttons **DOWN** + **UP**, and keep them pressed till the controller shows 0AD.
- With buttons **DOWN** and **UP** select 0AD or SAD: 0AD allows a calibration of 0, inserting a constant correction over the whole scale of measurement. SAD allows a calibration of the top part of the measurement scale with a proportional correction between the calibration point and 0.

- Press **SET** to display the value and then use **DOWN** + **UP** or **EXIT** to make the read value coincide with the value measured by the reference instrument.
- Exit from calibration by pressing button **EXIT**.

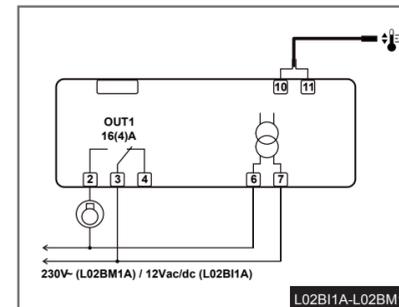
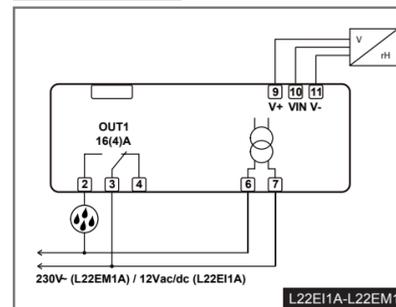
CONFIGURATION PARAMETERS

- Setup menu is accessed by pressing buttons **DOWN** + **UP** for 5 seconds.
- With button **DOWN** or **UP** select the parameter to be modified.
- Press button **SET** to display the value.
- By keeping button **SET** pressed, use button **DOWN** or **UP** to set the desired value.
- When button **SET** is released, the newly programmed value is stored and the following parameter is displayed.
- To exit from the setup, press button **EXIT** or wait for 30 seconds.

PAR	RANGE	DESCRIPTION
SCL	1°C; 2°C; °F	Readout scale. 1°C: measuring range -40/-19.9 ... 99.9/105°C for L02B-- 0.0 ... 100 %r.H. for L22E-- 2°C: measuring range -40 ... 105°C for L02B-- 0.0 ... 100 %r.H. for L22E-- °F: measuring range -40 ... 221°F for L02B-- Caution: upon changing the SCL value, it is then absolutely necessary to re-configure the parameters relevant to the absolute and relative temperatures (SPL, SPH, 1SP, 1HY, etc.).
SPL	-50..SPH	Minimum limit for 1SP setting
SPH	SPL.150°	Maximum limit for 1SP setting
1SP	SPL... SPH	Setpoint (value to be maintained in the room).
1Y	HY / PID	Control mode. With 1Y=HY you select control with hysteresis: parameters 1HY and 1CT are used. With 1Y=PID you select a Proportional-Integral-Derivative control mode: parameters 1PB, 1IT, 1DT, 1AR, 1CT will be used.
1HY	-19.9...19.9°C -19.9...19.9%r.H.	Thermostat differential [control with hysteresis]. Set 1HY on a value greater than zero to make the output work in refrigerating mode, vice versa set on a value lower than zero to make the output work in heating mode. With 1HY=0 the output is always off.   <p>Fig. 1a. ON/OFF refrigerating control (1Y=HY, 1HY>0) Fig. 1b. ON/OFF heating control (1Y=HY, 1HY<0)</p>
1PB	-19.9...19.9°C -19.9...19.9%r.H.	Proportional band [PID control]. Set 1PB on a value greater than zero to make the output work in refrigerating mode, vice versa set on a value lower than zero to make the output work in heating mode. With 1PB=0 the output is always off.  <p>With a proportional controller, the temperature is controlled by varying the time of activation of the output. The nearer the temperature to set point, the less time of activation. A small proportional band increases the promptness of response of the system to temperature variations, but tends to make it less stable. A purely proportional control stabilises the temperature within the proportional band but does not cancel the deviation from the set point.</p>
1IT	0...999s	Integral action time [PID control].  <p>The steady-state error is cancelled by inserting an integral action into the control system. The integral action time, determines the speed with which the steady-state temperature is achieved, but a high speed (1IT low) may be the cause of overshoot and instability in the response. With 1IT=0 the integral control is disabled.</p>
1DT	0...999s	Derivative action time [PID control].  <p>Response overshoot in a system controlled by a Proportional-Derivative controller may be reduced by inserting a derivative action in the control. A high derivative action (1DT high) makes the system very sensitive to small temperature variations and causes instability. With 1DT=0 the derivative control is disabled.</p>
1AR	0...100%	Reset of integral action time referred to 1PB [PID control]. Decreasing the parameter 1AR reduces the integral control action zone, and consequently the overshoot (see figure on paragraph 1IT).
1CT	0...255s	Cycle time. In the ON/OFF control (1Y=HY), after the output has switched on or off, it will remain in the new state for a minimum time of 1CT seconds, regardless of the temperature value. In the PID control (1Y=PID), the cycle time is the period of time in which the output completes a cycle (Time ON + Time OFF). The faster the system to be controlled reacts to temperature changes, the smaller the cycle time should be, in order to obtain a greater temperature stability and less sensitivity to load variations.
1PF	ON / OFF	Output state in case of probe failure.

BAU	NON / SBY	With BAU=SBY, the stand-by button is enabled.
SIM	0...100	Display slowdown.
OS1	-12.5...12.5°C	Probe T1 offset.
ADR	1...255	address for PC communication. (function not available)

WIRING DIAGRAMS



L02B... L22E

FANTINI COSMI S.p.A.
Via dell'Osio, 6
20090 Calepio di Settala, Milano, ITALY
Ph. +39 02 956821 | Fax +39 02 95307006
info@fantinicosmi.it
export@fantinicosmi.it

TECHNICAL DATA

Power supply
L02B1A/L22E1A 12Vac/dc±10%, 3W
L02BM1A/L22EM1A 230Vac±10%, 50/60Hz, 3W

Relay outputs
OUT1 16(4)A 240Vac

Inputs
L22E... 0-1V (LS160A)
L02B... NTC 10K (LS130)

Measuring Range
L22E... 0...100% U.R.
L02B... -40...105°C

Measuring accuracy
L22E... <±0.7%r.H. in the measuring range
L02B... <±0.3°C -40...100°C; ±1°C out of that range

Operating conditions
-10 ... +50°C; 15...80% r.H.

CE (Reference Norms)
EN60730-1; EN60730-2-9;
EN5022 (Class B);
EN50082-1

Front protection
IP55